


PLYWOOD  
 PLYWOOD SHALL BE NAILED TO FRAME  
 USING 30/2.8mmØ FLATHEAD NAILS OR  
 EQUIVALENT.  
 HORIZONTAL BUTT JOINTS SHALL BE PERMITTED  
 PROVIDED NAIL FIXED TO NOGGING AT 50mm  
 CENTRES.

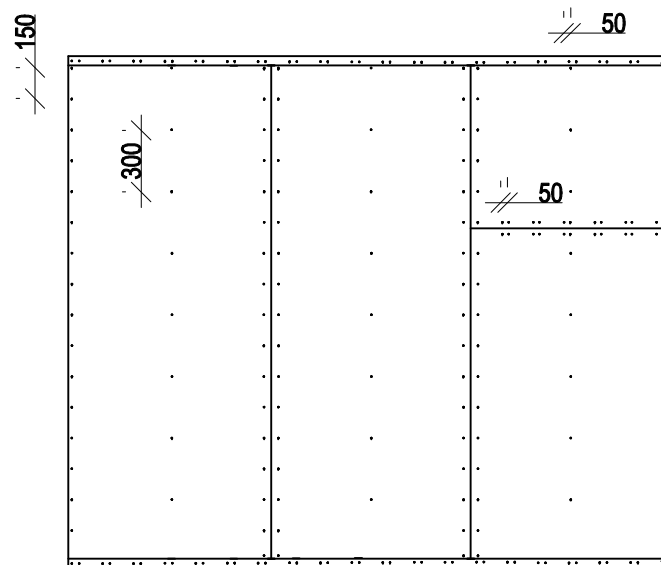

SHEETED PANEL SHALL BE  
 CONNECTED TO SUB FLOOR

### TYPE H METHOD 'B'

### BRACING N2

DIRECTION	AREA	PRESSURE	HT. FACTOR	REQUIRED	ACHIEVED
↑↓	22.8m <sup>2</sup>	0.72	0.9	18.3 Kn	27.0 kN
←→	32.4m <sup>2</sup>	0.61	0.9	22.0 kN	27.0 kN

A= 6kN/m plywood bracing as per AS1684.2-2006  
 Table 8.18 'h'.

NOTE: SUBFLOOR BRACING BETWEEN POSTS  
 TO ENGINEERS DESIGN

FASTENER SPACING =50mm  
 VERTICAL EDGES=150mm  
 INTERMEDIATE STUDS=300mm

BRACING CAPACITY=6.0 kN/M

MINIMUM PLYWOOD  
 THICKNESSES (mm)

STRESS GRADE	STUD SPACING (mm)	
	450	600
F8	7	9
F11	6	7
F14	4	6
F27	4	4.5